


## FTS / FTP Test Blocks & Plugs



Testing Solutions  
for  
Electric Power

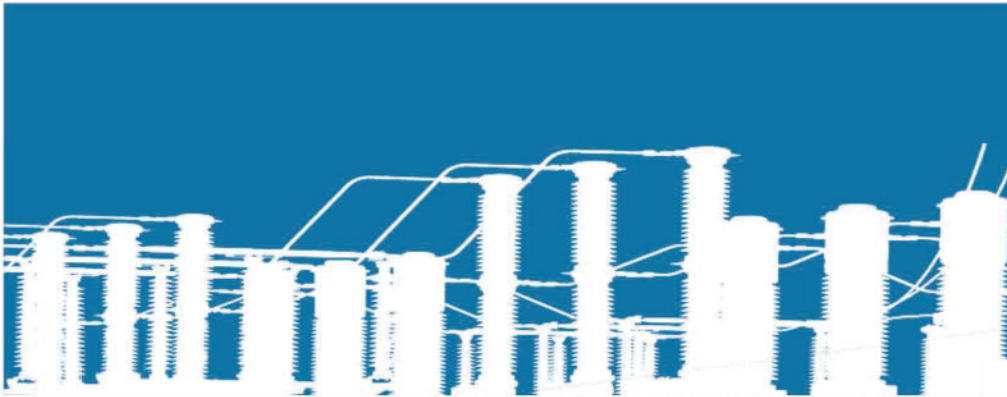

**INCREASE SAFETY & EFFICIENCY**  
**ALLOWS TEST DURING OPERATION**



The FTS is a test block for interfacing substation devices (protection relays, fault recorders, revenue meters, . . . ) to the voltage and current transformers and to other equipment on the system side of a power grid.

The FTP is a test plug keyed to a particular configuration of FTS Test Blocks. Once inserted into the corresponding Test Block, the FTP Plug isolates the substation device from the system side equipment while at the same time allowing connection of test equipment for secondary injection tests.

### Key Features

- Finger-safe Test Block and Test Plug increase safety during testing.
- Test Plugs are keyed to the corresponding Test Blocks and help eliminate errors.
- Construction of Test Plugs prevents contact between test set and current and voltage transformers during insertion / removal and allows test during operation.
- Built-in time-sequencing of disconnection / reconnection operations prevents spurious breaker operation.
- Extremely low internal resistance ( $< 2 \text{ m}\Omega$ ) helps reduce heat inside cabinets and panels.
- Available in 4, 6, 8, 10, 12, 14, 16, 18 or 20 pole configurations.

### Technical Specifications

<b>Current withstand</b>	30 A continuous 500 A for 1 second
<b>Maximum voltage</b>	600 V
<b>Contact resistance</b>	$\leq 2 \text{ m}\Omega$
<b>Dielectric withstand</b>	3.0 kV RMS for 1 minute between adjacent contact pairs and between any contact pair and other metal parts 3.0 kV RMS for 1 minute between open contacts when test plug is inserted
<b>Voltage impulse</b>	3 positive and 3 negative impulses of 5 kV peak, 1.2/50 $\mu\text{s}$ , 0.5 J between adjacent contact pairs and between all contact pairs and other metal parts
<b>UL94 flammability class</b>	V-0
<b>Enclosure protection</b>	IP50

FTS / FTP Test Blocks and Plugs are classified as electromagnetically benign and are therefore excluded from the scope of the European Community EMC Directive 2004/108/EC.

FTS / FTP Test Blocks and Plugs meet or exceed all requirements from ANSI / IEEE C37.90-2005.

**SecuControl**® [www.secucontrol.com](http://www.secucontrol.com)

**North America**  
SecuControl, Inc.  
2873 Duke Street  
Alexandria, VA 22314, USA  
ph: +1 703 838 7677  
mail@secucontrol.com

**Europe**  
SecuControl GmbH  
Ascherslebener Str. 3  
D-06333 Hettstedt, Germany  
ph: +49 3476 550 022  
info@secucontrol.com

**South America**  
SecuBrasil Ltda  
Rod. Jose Carlos Daux, 8600  
88050-001 Florianopolis SC, Brazil  
ph: +55 48 3371 1670  
comercial@secubrasil.com